


Ref C8-OBz prep TLC
 Group Bures_J
 C13_CPD_Night256

CDCl3 /mnt/nimrddata/Bures_J/11997ca

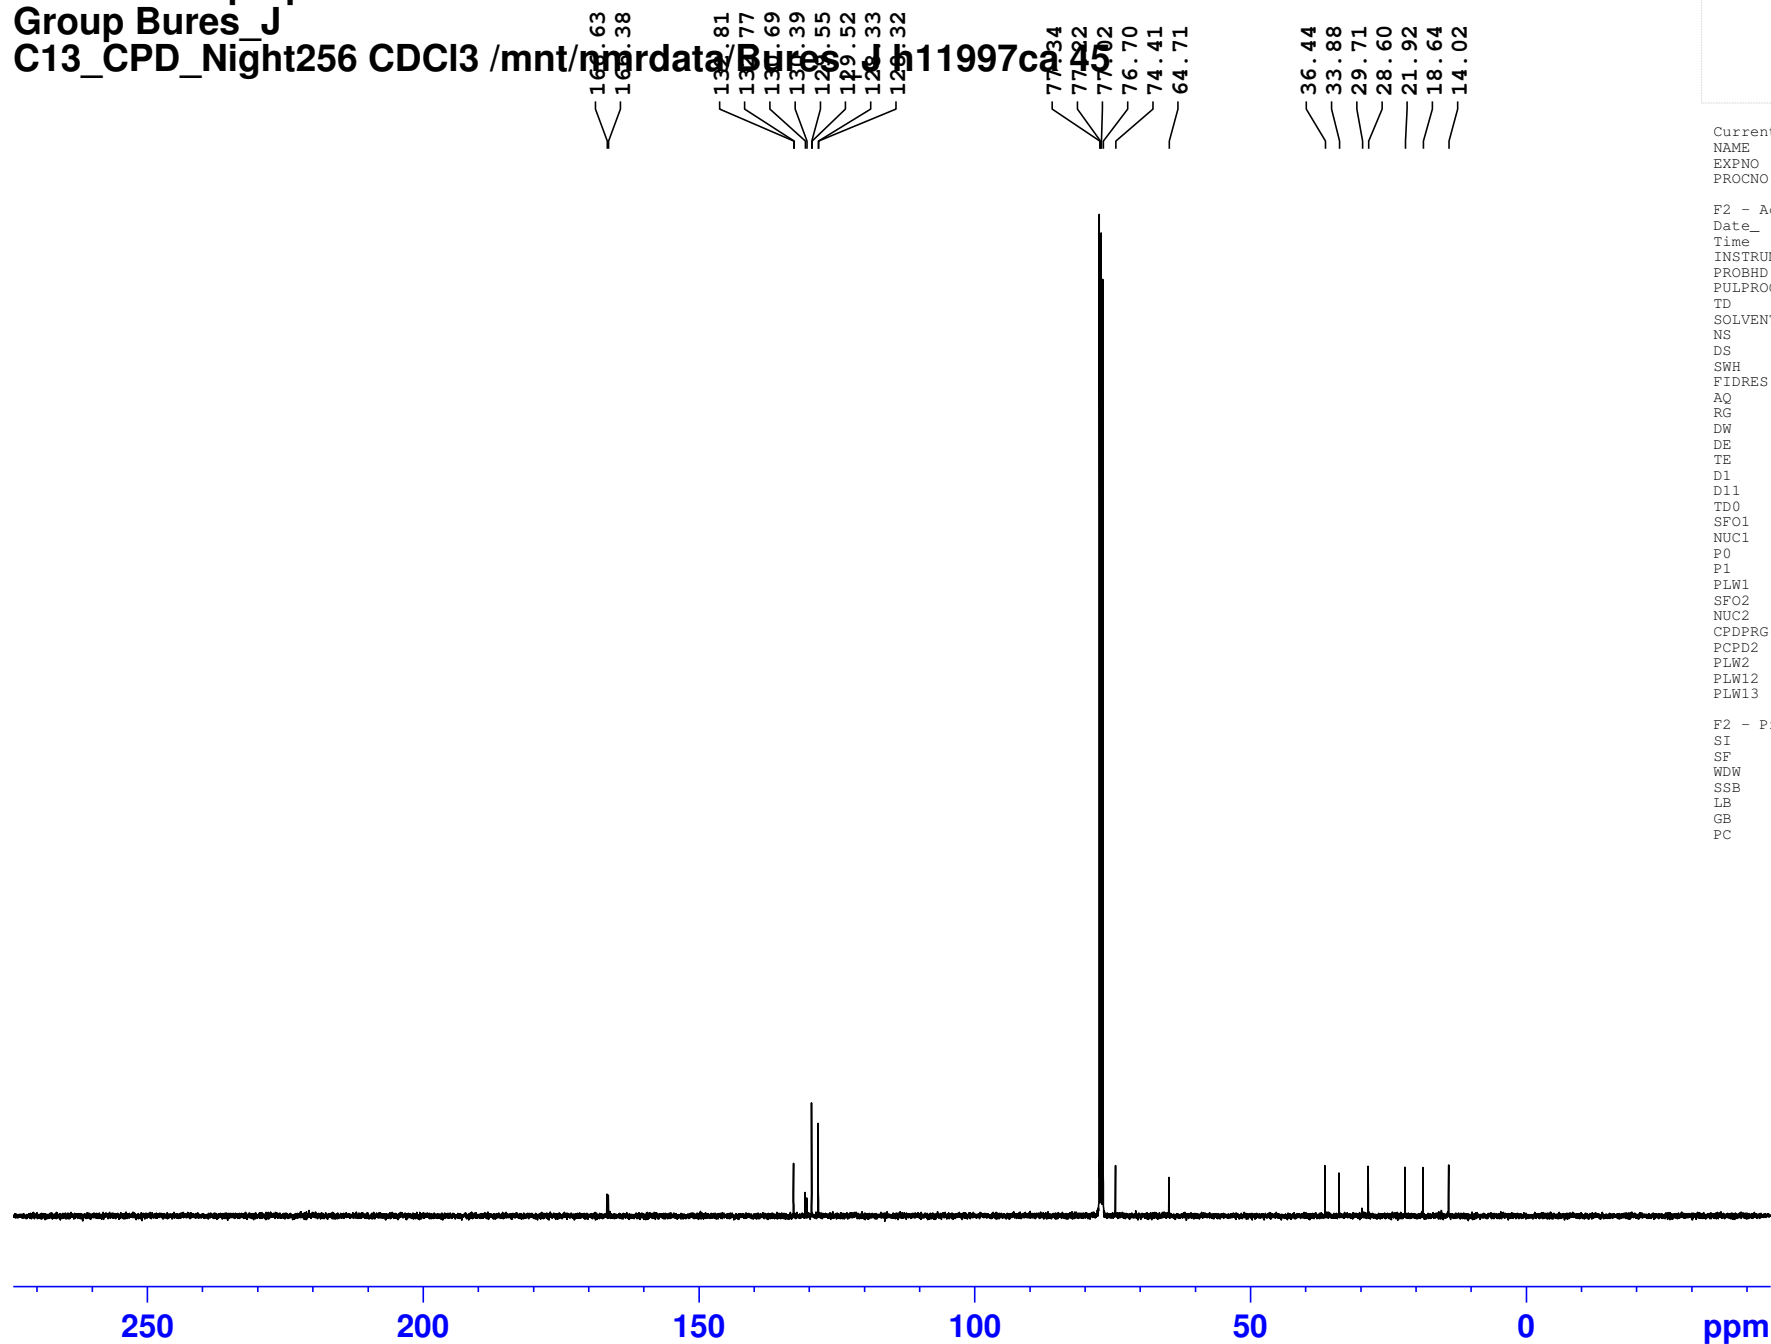

Current Data Parameters
 NAME 20190724-1653-B400_B.11-45
 EXPNO 11
 PROCNO 1

F2 - Acquisition Parameters
 Date_ 20190725
 Time 5.16 h
 INSTRUM spect
 PROBHD Z130030_0009 (
 PULPROG zgpg30
 TD 65536
 SOLVENT CDCl3
 NS 256
 DS 4
 SWH 32051.281 Hz
 FIDRES 0.978127 Hz
 AQ 1.0223616 sec
 RG 71.8
 DW 15.600 usec
 DE 41.97 usec
 TE 298.0 K
 D1 2.00000000 sec
 D11 0.03000000 sec
 TD0 1
 SFO1 100.6092502 MHz
 NUC1 13C
 P0 3.33 usec
 P1 10.00 usec
 PLW1 33.00000000 W
 SFO2 400.0716003 MHz
 NUC2 1H
 CPDPRG[2] waltz16
 PCPD2 90.00 usec
 PLW2 7.40000010 W
 PLW12 0.13598000 W
 PLW13 0.06839600 W

F2 - Processing parameters
 SI 32768
 SF 100.5976815 MHz
 WDW EM
 SSB 0
 LB 1.00 Hz
 GB 0
 PC 1.40