


Ref C10_oxime
Group Bures_J
C13_CPD_Night1024

1024 CDCl3 /mnt/nmrData/Bures_J h11997022

154.67
153.98

77.34
77.23
77.13
76.71
71.59
71.55

37.52
37.47
36.89
36.62
31.86
29.44
25.31
24.85
22.63
22.41
22.22
14.04

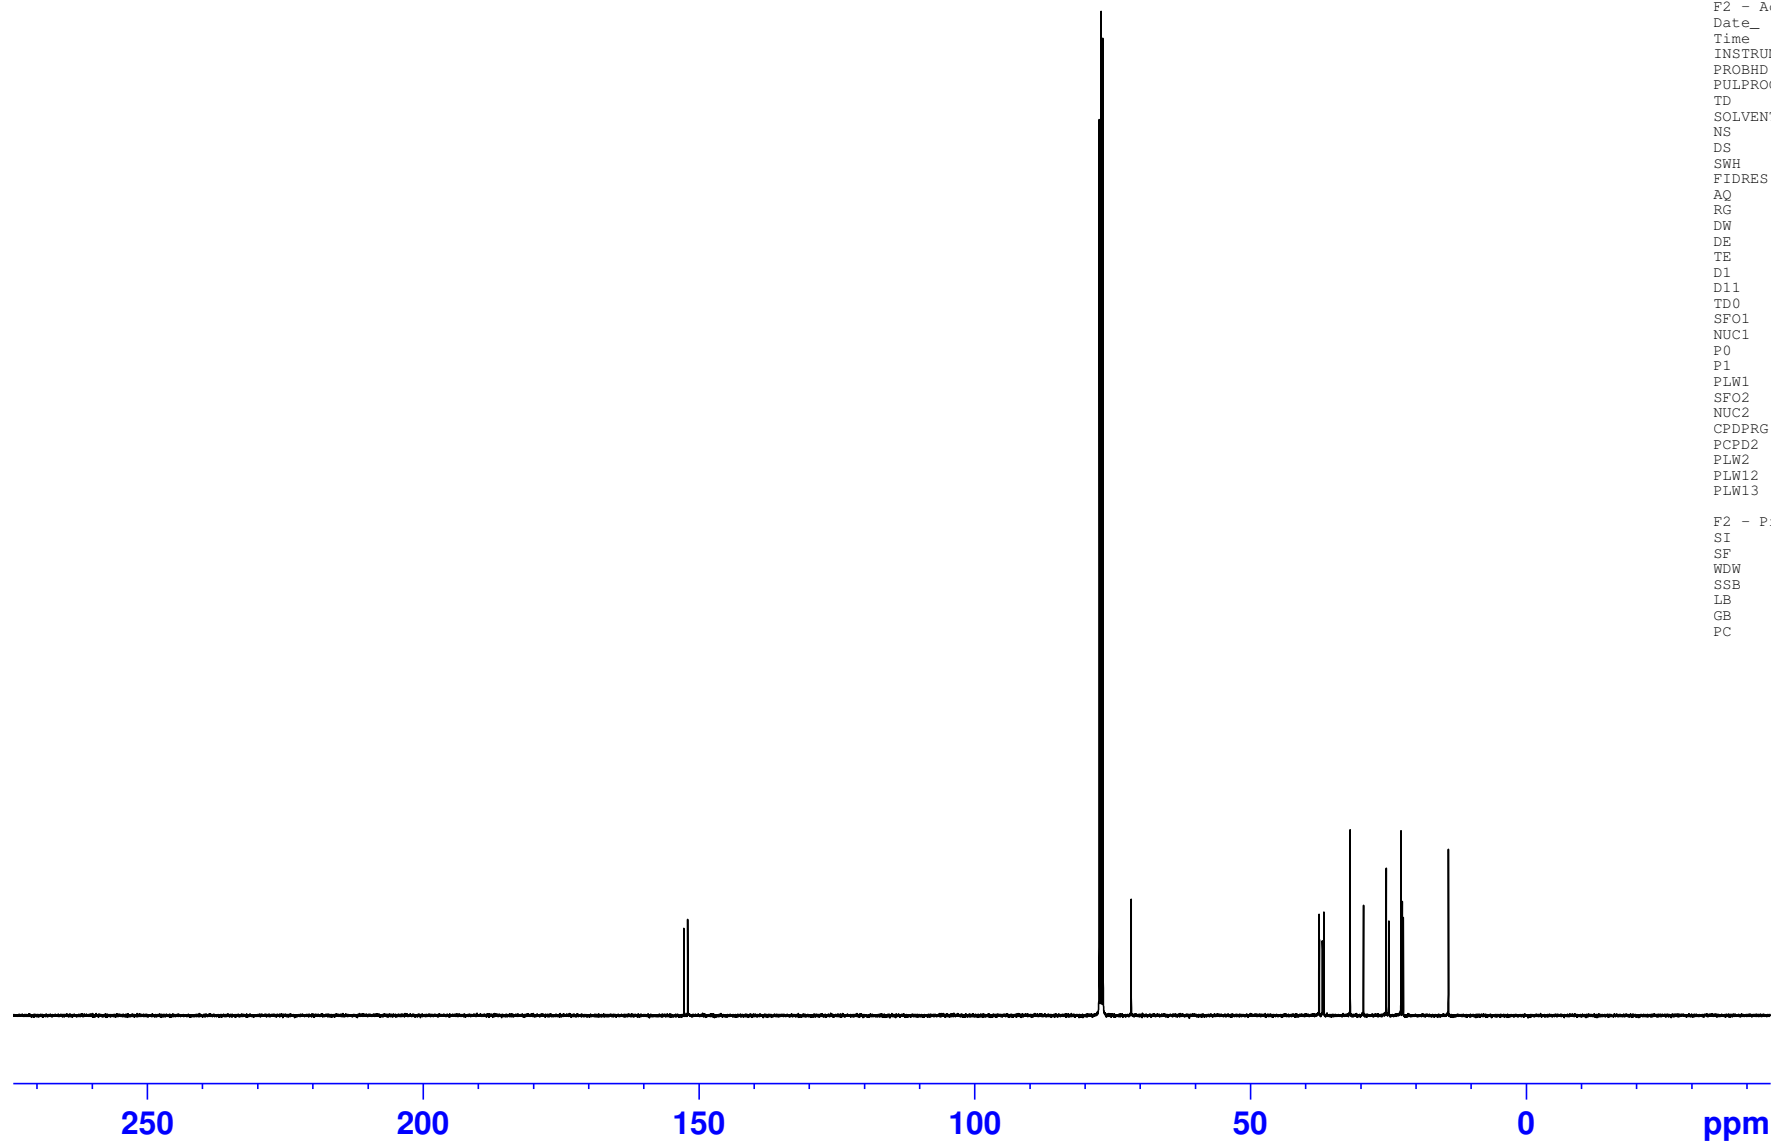

Current Data Parameters
NAME 20190807-1828-B400_B.11-32
EXPNO 11
PROCNO 1

F2 - Acquisition Parameters
Date_ 20190808
Time 0.37 h
INSTRUM spect
PROBHD Z130030_0009 (
PULPROG zgpg30
TD 65536
SOLVENT CDCl3
NS 1024
DS 4
SWH 32051.281 Hz
FIDRES 0.978127 Hz
AQ 1.0223616 sec
RG 71.8
DW 15.600 usec
DE 41.97 usec
TE 298.0 K
D1 2.00000000 sec
D11 0.03000000 sec
TD0 1
SFO1 100.6092502 MHz
NUC1 13C
P0 3.33 usec
P1 10.00 usec
PLW1 33.00000000 W
SFO2 400.0716003 MHz
NUC2 1H
CPDPRG[2] waltz16
PCPD2 90.00 usec
PLW2 7.40000010 W
PLW12 0.13598000 W
PLW13 0.06839600 W

F2 - Processing parameters
SI 32768
SF 100.5976815 MHz
WDW EM
SSB 0
LB 1.00 Hz
GB 0
PC 1.40